

**GOVERNMENT OF WEST BENGAL
OFFICE OF THE DIVISIONAL FIRE OFFICER
WEST BENGAL FIRE & EMERGENCY SERVICES
L.M. Dey Garden, D.H. Road, Silpara, Pin - 700008**

Memo No : IND/WB/FES/20192020/78540

DATE: 08/01/2020

From :

**The Divisional Fire Officer
Fire Prevention Wing,
West Bengal Fire & Emergency Services.**

To :

**BBIT PUBLIC SCHOOL
NISCHINTAPUR, BUDGE BUDGE,
SOUTH 24 PARGANAS, KOLKATA-
Budge Budge F.S., Budge Budge,
South 24 Parganas - 700137 .**

Sub :Renewal of Fire Safety Certificate for the occupancy of an existing construction of G + 3 storied building under Group Educational at the premises no. NISCHINTAPUR, BUDGE BUDGE, DIST.-SOUTH 24 PARGANAS,PIN.- 700137.

This is in reference to your Application No. IND/WB/FES/20192020/78540,dated 08/01/2020, regarding the Renewal of Fire Safety Certificate for the occupancy of an existing construction of G + 3 storied building under Group Educational at the premises no. NISCHINTAPUR, BUDGE BUDGE, DIST.-SOUTH 24 PARGANAS,PIN.- 700137.

The performance of the Fire Fighting System as incorporated in the buildings were tested at random and found satisfactorily working condition. In view of the above this office is releasing the Renewal of Fire Safety Certificate for occupancy of the aforesaid building.

However to up-keep the Fire Safety Measure of the aforesaid building the following safety measures need to be incorporated / maintained.

1. Driveway must be free from any type of obstruction for easy movement of Fire



- Appliances. No parking will be allowed on the driveway.
- 2.The interior finish decoration of the building shall be with low flame spread material confirming I.S. specification.
 - 3.To eliminate risk of Fire hazards, good housekeeping both for inside and outside of the building shall be strictly maintained.
 - 4.Existing electrical wiring of the whole building shall have to be carefully checked for wear and tear in them, particularly lines above false ceiling.
 - 5.The notice of Fire fighting and evacuation from the building shall be prepared and displayed at all vulnerable place of the building.
 - 6.The employees and security staff shall be conversant with installed Firefighting equipments of the building and to operate in the event of Fire and testing.
 - 7.Mock Fire practice and evacuation drill shall be performed periodically with participants of all the occupants of the building.
 - 8.Electrical switch gear room shall be protected with automatic CO2 or D.C.P Fire extinguisher confirming I.S. specification.
 - 9.First aid Fire fighting system shall be provided as per I.S. specification.
 - 10.Arrangement shall have to be made for regular checking, testing and maintenance of all the Firefighting installation in the building to keep them in perfectly good working condition at all the times.
 - 11.If required the old lines shall have to be replaced with new lines, the cable shall always be laid in M.S. Conduits pipes continuously bonded with earth.
 - 12.Periodical flashing of water from the fire water pipe line shall be made to maintain efficient working performance of above mentioned system.
 - 13.This F.S.C. is valid for 03(Three) years from the date of issue of this letter.
 - 14.R.F.S.C is to be obtained from the Divisional Fire Officer, West Bengal Fire & Emergency Services, for performances of all the Life and Fire Safety arrangements and installation of the building.

Divisional Fire Officer
West Bengal Fire & Emergency Services

Signature valid

Digitally signed by DIPAK
KUMAR GHOSH
Date: 2020.01.08 16:56:40 IST



FIRE SAFETY (INDIA)

186/1, Purba Putiary, Dakshin Para,
Kolkata - 700 093

Mobile : 8240199755, 9830228792


E-mail : firesafetyindia2017@gmail.com

Date: 19.09.2020

FITNESS CERTIFICATE OF FIRE EXTINGUISHERS

This is to certify that we have supplied the following No. of Fire Extinguishers /
Refills To M/s..... BBIT
of... Nischintapur, Budde Budde, Kolkata-700137.

1. New / Refill DCP Type Fire Extinguishers, Capacity - 4kg/5kg/6kg/9kg/10kg/25kg/50kg/75kg.
(Qty-57 Nos & 1 No) - O.K.
2. New / Refill ABC Type Fire Extinguishers, Capacity - 2kg/4kg/5kg/6kg/9kg/10kg/25kg.
3. New / Refill CO₂ Type Fire Extinguishers, Capacity - 2kg/3kg/4.5kg/6.5kg/9kg/22.5kg.
4. New / Refill Water CO₂ Type Fire Extinguishers, Capacity - 9ltr / 50 ltr.
5. New / Refill Mechanical Foam (AFFF) Type Fire Extinguishers, Capacity - 9ltr / 50 ltr.

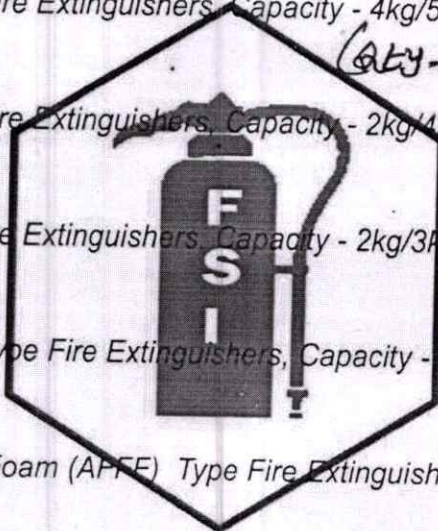

Now it is confirm to us that all the above fire Extinguishers are in good and working
condition and its Chemical Valid up to... 18th September 2021

Pressure type Chemical Valid up to.....



For FIRE SAFETY (INDIA)

Sales & Service Dept.